

Standalone MONOline 764

for monitoring of AsH₃



Features

- The MONOline monitor displays the detector gas concentration with name and alarm status
- The MONOline is factory calibrated and ready to use. Other measuring ranges are available on request
- 24VDC or 230VAC power supply
- Internal sounder alarm
- Clearly visible flashing beacon alarm (optional) Clearly visible flashing beacon alarm (optional)
- Alarm status clearly visible on the OLED-Display
- 3 internal relays available to activate ventilation fans or alarming units
- Different relay functions programmable (Reset manual or automatic, NO/NC) and alarm thresholds by magnet pen Different relay functions programmable (Reset manual or automatic, NO/NC) and alarm thresholds by magnet pen
- Electrochemical sensor technology with simple concept for replacing a sensor Electrochemical sensor technology with simple concept for replacing a sensor
- Different relay functions programmable (Reset manual or automatic, NO/NC) and alarm thresholds by magnet pen Different relay functions programmable (Reset manual or automatic, NO/NC) and alarm thresholds by magnet pen
- integrated MODBUS RTU interface
- Connector for remote RESET
- Robust IP 54 enclosure
- Product has been developed by KIMESSA and is manufactured in Switzerland

Standalone MONOline 764

Alarm thresholds:	2 free programmable per gas detector
Warranty:	12 month warranty

Housing

Housing protection:	IP 54
Material:	Thermoplast
Weight:	820 g


Specifications electronic

Wiring analogue:	3x 0,75 mm ² , shielded
Wiring digital:	4x 1,0 mm ² , shielded
Supply:	230 VAC/ 24 VDC
Power consumption:	max. 200 mA
Output signal analogue:	4...20 mA / 0...20 mA
Output signal digital:	KIMESSA CANBUS / Modbus RTU
Switching output:	3 potential free (2A)

Specifications construction

Cable gland:	cable bushing plate
Cable entry:	bottom
Tests:	CE
Display:	OLED-Display
Position:	depending on display
RESET-Connector:	yes
Volume:	92 dB

Electronic and Dimensions

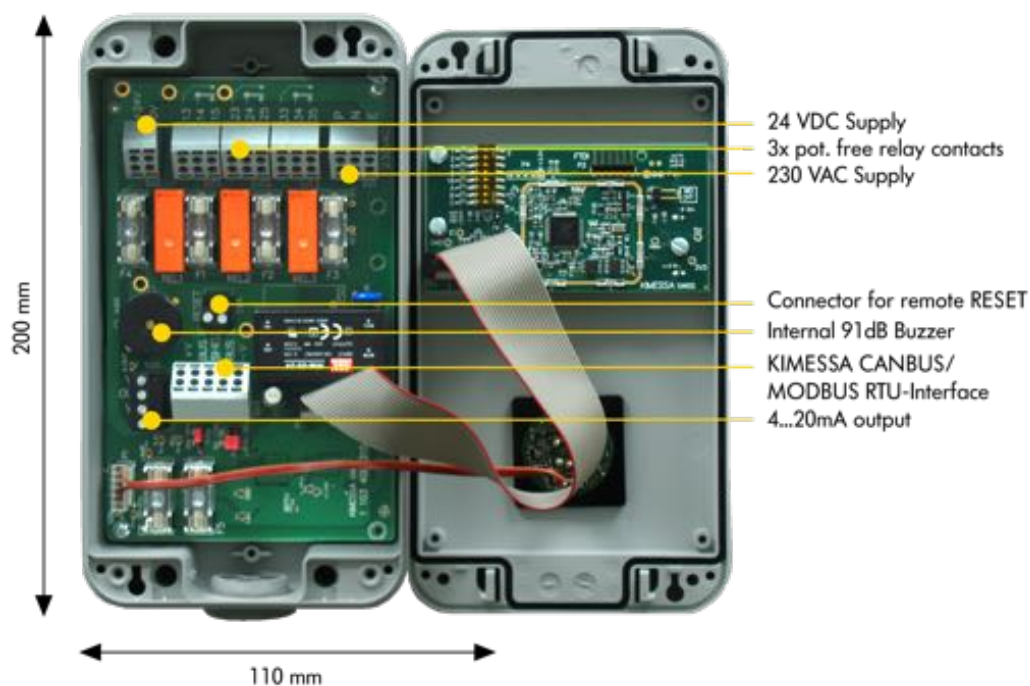

Inspection (Maintenance)

The sensor and the electronic require an inspection. Routine calibration is recommended once or twice a year.